

### H1800 TT

Capacity 1800 Litres  
400 Gallons  
Length 2170 mm  
Width 1125 mm  
Height 1170 mm



### H2500 TT

Capacity 2500 Litres  
550 Gallons  
Length 2265 mm  
Width 1285 mm  
Height 1315 mm



### V1300 TT

Capacity 1300 Litres  
285 Gallons  
Diameter 1210 mm  
Height 1415 mm



### V2500 TT


Capacity 2500 Litres  
550 Gallons  
Diameter 1635 mm  
Height 1450 mm



## Domestic Oil Storage Regulations

[www.titanenv.com](http://www.titanenv.com)  
Email: [sales@titanenv.com](mailto:sales@titanenv.com)

Seapatrick Road, Seapatrick,  
Banbridge, Co. Down,  
Northern Ireland BT32 4PH.  
Telephone: +44 (0) 28 4062 6260  
Fax: +44 (0) 28 4062 6259

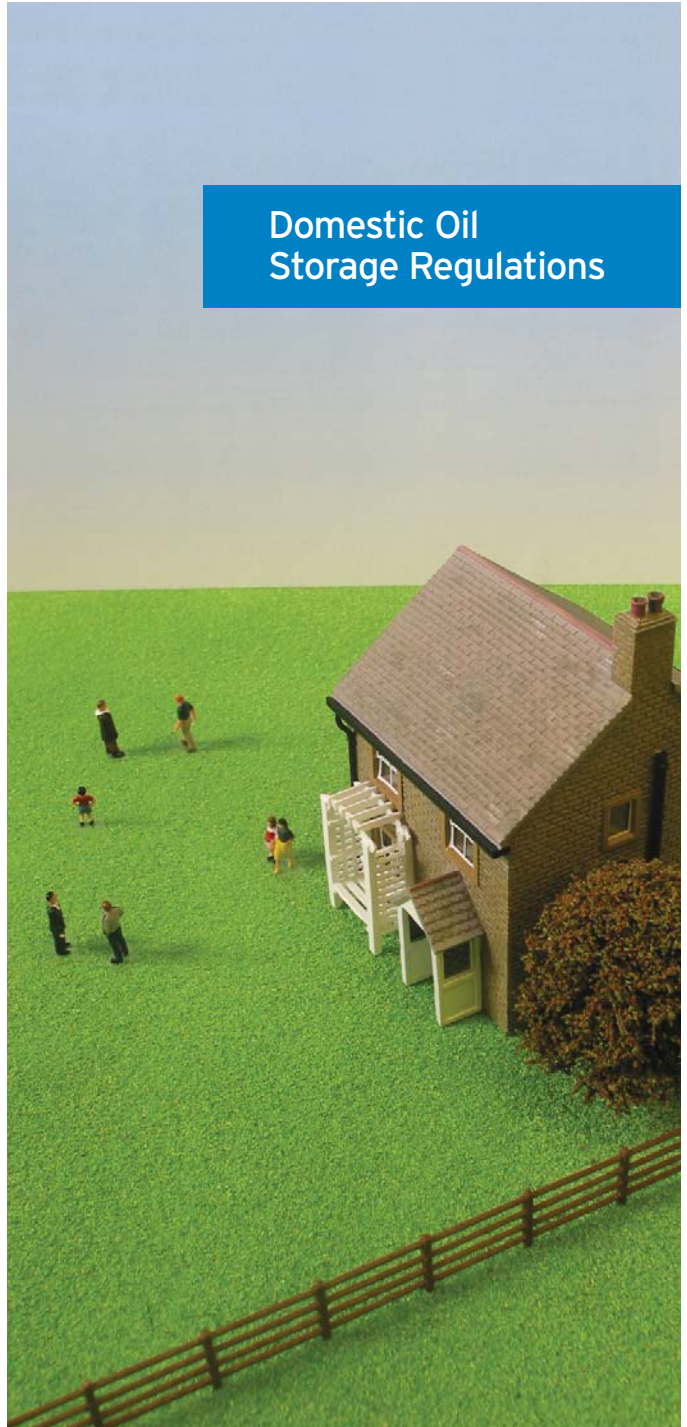



## Regulations

The oil and fuel storage regulations are there to protect the environment and to protect your home. Large fines and the cost of a clear-up following a spill can be severe, so it's time to look at your oil and fuel storage.

**Q. WHAT REGULATIONS AFFECT DOMESTIC FUEL STORAGE?**

The Control of Pollution (Oil Storage) (England) Regulations 2001.

**Q. TO WHICH SITES DO THEY APPLY?**

Private dwellings storing over 3500 litres but it should be noted that Building Regulations reduce this to 2500 litres.

**Q. WHAT IS THE TIMESCALE?**

The timescale for The Control of Pollution (Oil Storage) (England) Regulations 2001 was 1st September 2005, whereby all relevant domestic installations affected must be bundled.

**Q. HOW CAN I ENSURE THAT A BUND COMPLIES WITH THE REGULATIONS?**

Install an integrally banded tank (OFST100). Alternatively, you could build a masonry or concrete bund that complies with the stringent requirements of the Pollution Prevention Guidance notes PPG 2 (above ground oil storage tanks) and PPG 26 (oil drum storage) issued by the Environment Agency. Masonry and concrete bunds are covered by Ciria Report 163.

The Titan Environmental banded range of EcoSafe tanks will meet all your regulatory needs in one easy step.

**Q. IF I INSTALL THE WRONG TYPE OF TANK NOW, MUST IT BE CHANGED?**

Yes. It must be replaced with a banded tank, or be banded straight away.

**Q. WHERE ELSE SHOULD A BUNDED TANK BE INSTALLED?**

When on completion of the OFTEC form TI/133 (risk assessment) by an OFTEC qualified engineer, your tank is deemed to need bunding. See the checks below:

- Tank capacity in excess of 2500 litres?
- Tank within 10 metres of controlled water?
- Tank located where a spillage could run into an open drain or to a loose fitting manhole cover?
- Tank within 50 metres of a borehole or spring?
- Tank over hard ground or hard-surfaced ground that could enable spillage run-off to reach controlled water?
- Tank located in a position where the vent pipe outlet is not visible from the fill point?
- Tank supplying heating oil to a building other than a single family dwelling?

Please contact Titan with any queries or if you would like to be put in contact with a Titan Accredited Installer for an oil storage tank inspection.



**ES1000**

Capacity 1000 Litres  
220 Gallons  
Length 2140 mm  
Width 695 mm  
Height 1500 mm



**ES1225**

Capacity 1225 Litres  
270 Gallons  
Length 2000 mm  
Width 900 mm  
Height 1495 mm



**ES1300**

Capacity 1300 Litres  
285 Gallons  
Length 1935 mm  
Width 1265 mm  
Height 1310 mm



**ES1800**

Capacity 1800 Litres  
400 Gallons  
Length 2360 mm  
Width 1300 mm  
Height 1345 mm



**ES2500**

Capacity 2500 Litres  
550 Gallons  
Length 2450 mm  
Width 1425 mm  
Height 1465 mm



**ES3500**

Capacity 3500 Litres  
770 Gallons  
Diameter 2180 mm  
Height 1940 mm



**ES5000**

Capacity 5000 Litres  
1100 Gallons  
Diameter 2230 mm  
Height 2420 mm



**TITAN**



**LP1200 TT**

Capacity 1200 Litres  
260 Gallons  
Length 1785 mm  
Width 1370 mm  
Height 925 mm



**R1000 TT**

Capacity 1000 Litres  
220 Gallons  
Length 1910 mm  
Width 590 mm  
Height 1350 mm



**R1225 TT**

Capacity 1225 Litres  
270 Gallons  
Length 1745 mm  
Width 750 mm  
Height 1385 mm



**H1300 TT**

Capacity 1300 Litres  
285 Gallons  
Length 1735 mm  
Width 1090 mm  
Height 1145 mm

